

niko

SWISS GARDE 360 PRESENCE DETECTORS KNX/N

APPLICATION DESCRIPTION

MODEL

TYPE NO.

SG360P KNX/N

25020N

nv Niko sa
Industriepark West 40, 9100 Sint-Niklaas, Belgium
www.niko.eu

Germany:	+49 7623 96697-0	support.de@niko.eu
Switzerland:	+41 44 878 22 22	support.ch@niko.eu
Austria:	+43 1 7965514	support.at@niko.eu
Poland:	+48 509 378 373	support.pl@niko.eu
Other:	+32 3 778 90 8	support@niko.eu

The data contained herein is subject to change without notice. Niko nv sa does not warrant for correctness or completeness of the document.

The reproduction, transmission or use of this document or its contents is not permitted without the written permission of Niko nv sa. All rights reserved.

Edition December 2021

CONTENT

1. Functional Description	4
2. Communication objects	5
3. Parameters	7
3.1 General.....	7
3.2 Lighting.....	8
3.3 HCV.....	9
3.4 Brightness / Threshold Switch.....	10
3.5 Calibration Brightness Value.....	11
3.6 Evaluation PIR	12
3.7 Constant Light Control	13
3.8 Constant Light Parameters.....	14
3.9 Table Deadband	15
4. Functional Blocks	136
4.1 Light Control Channel.....	17
4.1.1 Object 0 Output – Light - Switch	17
4.1.2 Object 1 External Switch / Status – Light - Switch	17
4.1.3 Object 2 External Movement – Light - Switching	187
4.1.4 Object 3 Input – Light - Lock.....	18
4.2 HCV Channel.....	19
4.2.1 Object 4 Output - HCV - Switching.....	19
4.2.2 Object 5 External Switch / Status – Climate (HCV) - Switching	19
4.2.3 Object 6 External Movement - Light - Switching.....	19
4.2.4 Object 7 Input - Climate (HCV) - Lock.....	19
4.3 Brightness Threshold Switch	20
4.3.1 Object 8 Threshold Switch Brightness - Switching.....	20
4.3.2 Object 9 Brightness Value	20
4.4 AD Calibration Value	21
4.5 Objects for Constant Light Control.....	21
4.5.1 Object 16 Constant Light - Switch ON/OFF.....	21
4.5.2 Object 17 Constant Light - Dimming relative.....	21
4.5.3 Object 18 Constant Light - Dimming absolute.....	22
4.5.4 Object 20 Constant Light - Force Output.....	22
4.5.5 Object 21 Constant Light - Scene.....	22
4.5.6 Object 22 Constant Light - Output.....	22

1 FUNCTIONAL DESCRIPTION

The SWISS GUARD 360P KNX/KLR presence detector for flush ceiling mount features a KNX/EIB interface and is ideal for use in building automation systems.

The device is based on a modern microcontroller with internal flash memory and an integrated KNX/EIB bus coupler

Four pyro-detectors and a high-resolution lens can detect smallest movements.

The four PIR sensors can be activated individually or in groups.

A cadmium-free light sensor measures brightness and it has a linear output. It's built-in optical filter has a spectral response similar to that of the human eye.

The presence detector has two independent channels for lighting and HVAC control.

The detector can also be switched on and off using a special IR remote control.

Using the standard KNX/EIB bus all switching and control functions can be easily programmed and executed.

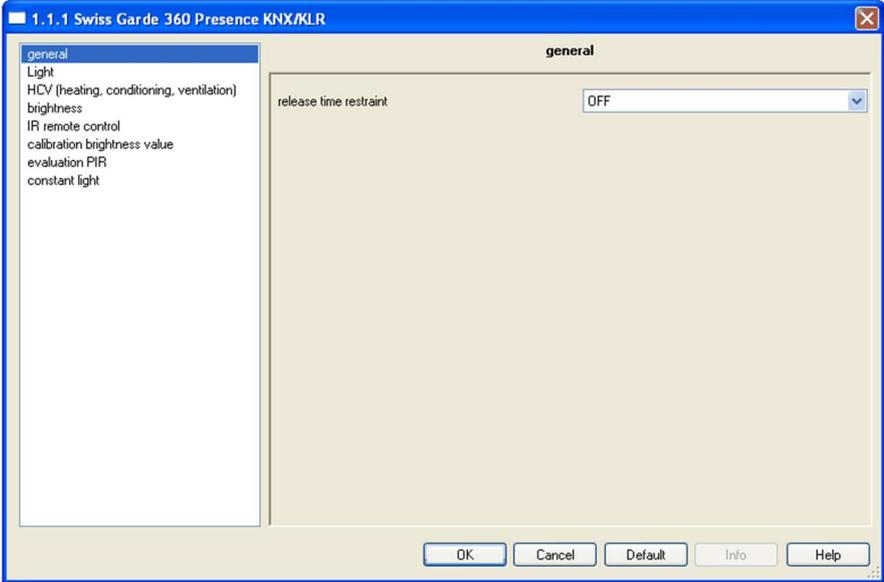
2 COMMUNICATION OBJECTS

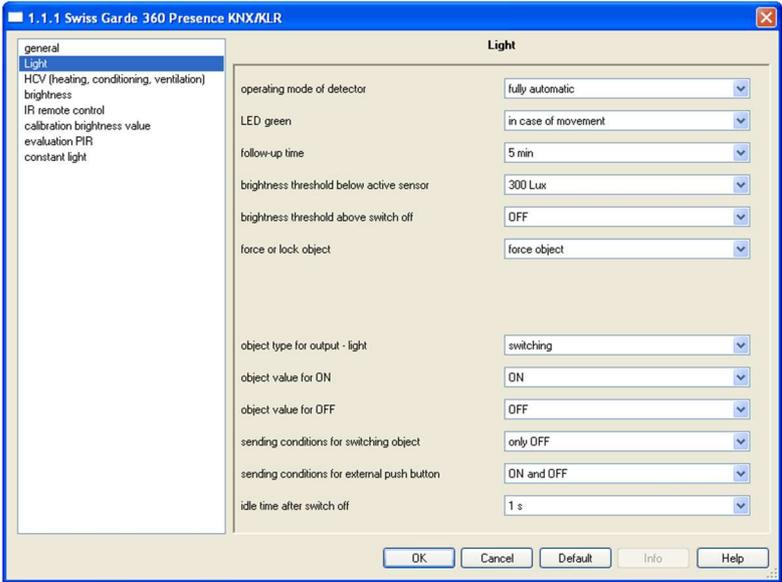
Object		Function	link application with:	Bit/Byte
0	←	Output - light (preset dimming)	light group actuator	1 byte
0	←	Output - light (switching)	light group actuator	1 bit
0	←	Output - light (scene)	light group actuator	1 bit
1	→	Input external switch / status - light (switching)	KNX switch, touch display, logic	1 bit
2	→	Input external motion - light (switching)	Output - light for secondary unit (object 0)	1 bit
3	→	Input - light (forced control)	<ul style="list-style-type: none"> External logic module 	2 bit
3	→	Input - light (lock)	KNX switch, touch display, logic module	1 bit
4	←	Output - HVAC (switching)	<ul style="list-style-type: none"> Actuators for HVAC devices such as heating, ventilation and air conditioning Control of alarm logic modules Presence function 	1 bit
5	→	External switch / status - HVAC (switching)	KNX switch, touch display, logic	1 bit
6	→	External motion - HVAC (switching)	Output HVAC for secondary unit (output object 4)	2 byte
7	→	Input - HVAC (forced control)	External logic module	2 bit
7	→	Input - HVAC (lock)	KNX switch, touch display, logic	1 bit
8	←	Threshold switch brightness (switching)	Logic, actuator	1 bit
9	←	Brightness (lux value)	Logic, touch display	2 byte
10	←	AD calibration value	Read out and then set manually for calibration procedure	2 byte
16	→	Constant light control, switch on/off	KNX switch , logic	1 bit
17	→	Constant light control, dimming relative	4 bit dimming object from KNX switch for ON/OFF, dimming up and down, touch display	4 bit
18	→	Constant light control, preset dimming	Logic module	1 byte
20	→	Constant light control, forced control	KNX button, logic	1 bit
21	→	Constant light control, scene selection	Logic module	1 byte
22	←	Constant light control, channel 1 - output	Dimming actuator for light group 1	1 byte

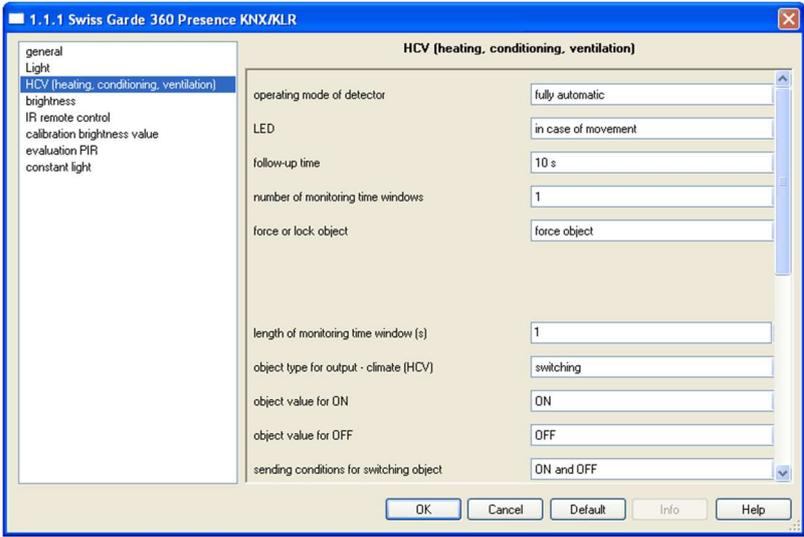
No	Name	in/out	Type	Selection
0	Output - light (dimming absolute)	out	DPT 5.001	1
0	Output - light (switching)	out	DPT1.001	1
0	Output - light (Scene)	out	DPT17.001	1
1	external switch / status - light (switching)	in	DPT 1	
2	external movement / status - light (switching)	in	DPT 1	
3	Input - light (force object)	in	DPT 2.001	2
3	Input - light (lock)	in	DPT 1.001	2
4	Output - HVAC (switching)	out	DPT 1.001	3
4	Output - HVAC (dimming absolute)	out	DPT 5.001	3
4	Output - HVAC (scene)	out	DPT17.001	3
5	External switch / status - HVAC (switching)	in	DPT 1.001	
6	External movement - HVAC (switching)	in	DPT 1.001	
7	Input - HVAC (forced object)	in	DPT 1.001	4
7	Input - HVAC (lock)	in	DPT 1.001	4
8	Brightness threshold (switching)	out	DPT 1.001	
9	Brightness	out	DPT 9.004	
10	AD calibration	in	DPT 7.001	
16	Constant light switching on / off	in	DPT 1.001	
17	Constant light dimming relative	in	DPT 3.007	
18	Constant light dimming absolute	in	DPT 5.001	
20	Constant light forced output	in	DPT 1.001	
21	Constant light scene	in	DPT17.001	
22	Constant light output dimming absolute	out	DPT 5.001	

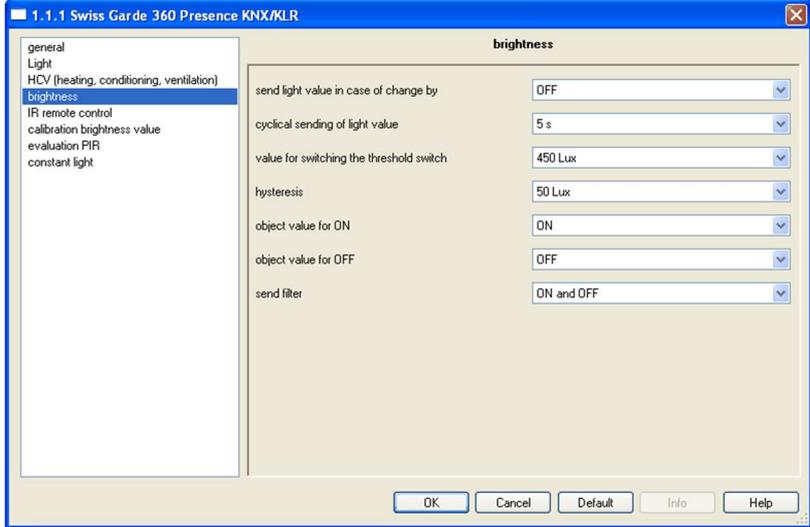
3 PARAMETERS

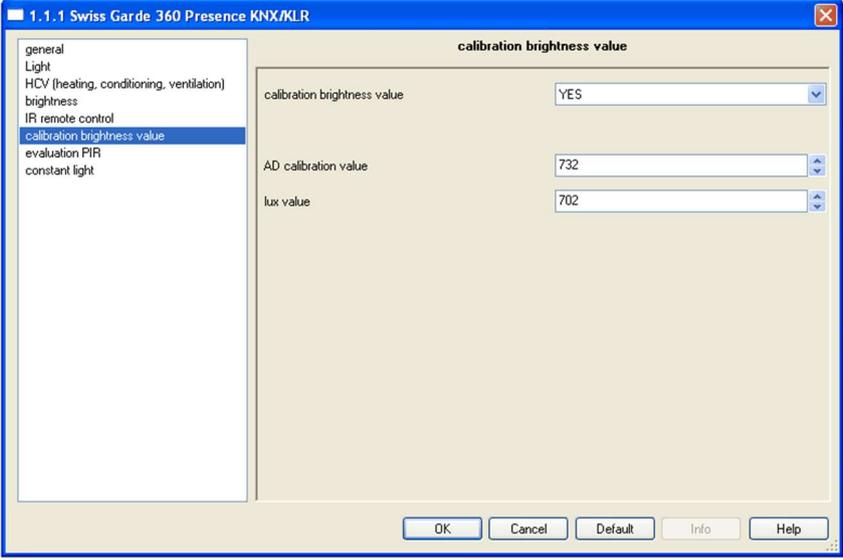
For the setting of the parameters, the SG360P KNX/KLR motion detector should be highlighted to the configuration or operating mode and then the command Parameter should be selected from the Edit menu item or via the context menu (right mouse click). The Edit parameter... window will open with multiple tabs.

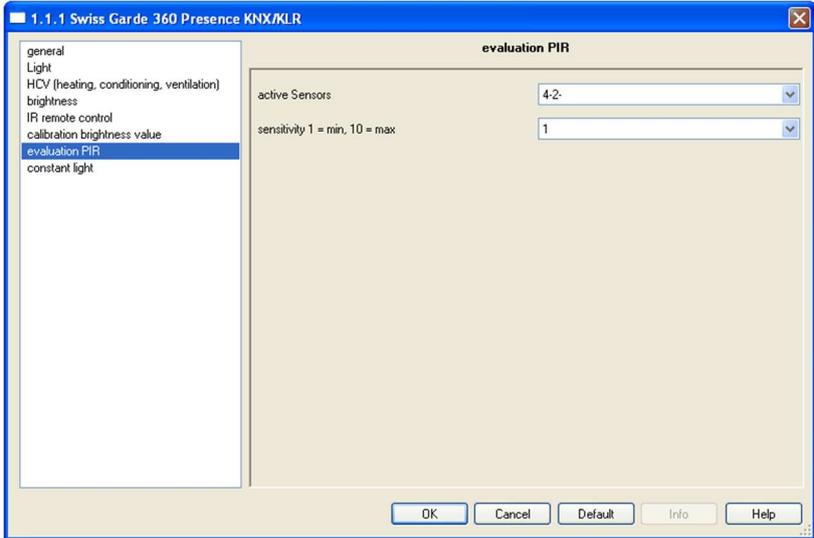
<p>3.1 General</p>	
<p><i>Reset time, forced control</i></p>	<p>The value "OFF" or a time of 5 min to 9 hrs can be selected from the reset time, forced control menu. This parameter defines the time delay for the detector to reset to AUTO mode, after a OFF or ON command has been executed.</p>

<h3>3.2 Lighting</h3>	
<i>operation mode of the detector</i>	Defines the the fully automatic or semi-automatic modes.
<i>green LED</i>	This LED can flash once after each motion detection or remain in off status
<i>follow-up time</i>	The <i>follow-up time</i> of the light channel can be set from 1s to 4 hrs.
<i>brightness threshold below sensor is active</i>	Set lighting value from 10 Lux to 2000 Lux. Important: in master-secondary detector mode all secondary detectors must be set to 2000 Lux (motion detection only).
<i>brightness threshold above lighting is turned off</i>	Maximum lux value for automatic switch-off, even if delay time has not yet elapsed
<i>force object or lock object</i>	This will set object 3. See description of object 3: <i>force mode – lock mode</i>
<i>If lock object = 0</i>	Selects an action after reception of a 0
<i>If lock object = 1</i>	Selects an action after reception of a 1
<i>object type for output - light</i>	This will set object 0. The following options are available: switching, dimming absolute, scene selection
<i>object value for ON for object type: light = switching light = dimming absolute light = scene</i>	select ON or OFF (default is ON) select dim value from 0% to 100% select scenes from 1...32
<i>object value for OFF for object type: light = switching light = dimming absolute light = scene</i>	select OFF or ON (default is OFF) select dim value from 0% to 100% select scenes from 1...32
<i>sending conditions for switching object</i>	transmission filter for object 0 output – light - switching: selection: ON and OFF, neither ON nor OFF, ON only, OFF only
<i>sending conditions for external push button</i>	selection: ON and OFF, neither ON nor OFF, ON only, OFF only
<i>idle time after switch off</i>	adjustable from 1 s to 60 s <u>applications:</u> <ul style="list-style-type: none"> • prevention off bus traffic excess • prevention of false lighting restart after: <ul style="list-style-type: none"> ➤ Cooling light bulbs ➤ leaving the room after switching off with a KNX push button

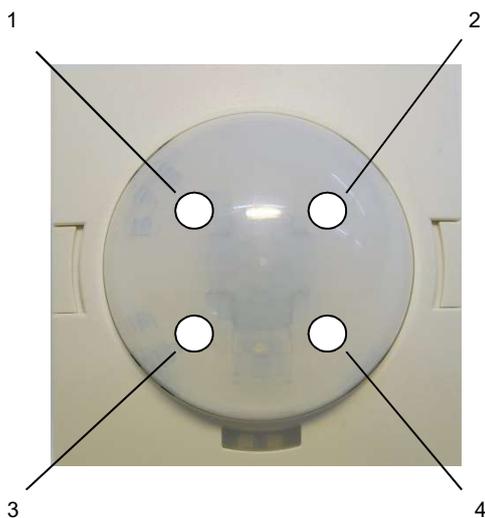
<h3>3.3 HCV</h3>	
	<p>All parameters are identical to those of the light channel with the exception of:</p>
<p><i>number of monitoring time windows</i></p>	<p>The number of the required monitoring time windows may be set from 1 to 32</p>
<p><i>length of monitoring time window</i></p>	<p>Adjustable from 1 s to 30'0000 s (8.33 hrs)</p>
<p>Attention:</p>	<p>Correct setting for the fastest response of the HVC Channel is: <i>Number of monitoring time windows: 1</i> <i>length of monitoring time window: 1s</i></p>

<p>3.4 Brightness / Threshold Switch</p>	
	<p>In the menu Brightness / Threshold Switch parameters can be set for the outputs of object 8 (<i>threshold switch brightness</i>, 1 bit) and object 9 (<i>brightness value</i>, 2 bytes).</p>
<p><i>send light value in case of change by</i></p>	<p>With this parameter, the lux value when exceeding the set threshold + change can automatically be sent via the object 9 (<i>brightness value</i>). Values from 10 lux up to 1800 lux and "OFF" can be set. The set value of change refers to the set threshold.</p>
<p><i>cyclic transmission of the light value</i></p>	<p>Values from 5 seconds to 30 minutes and „OFF“ can be set.</p>
<p><i>value for switching the threshold</i></p>	<p>Values from 10 Lux to 2000 Lux can be set.</p>
<p><i>hysteresis</i></p>	<p>Values from 5 Lux to 200 Lux can be parameterized</p>
<p><i>object value for ON</i></p>	<p>Selection ON or OFF</p>
<p><i>object value for OFF</i></p>	<p>Selection OFF or ON</p>
<p><i>send filter</i></p>	<p>Selections: „ON and OFF“; „neither ON nor OFF“; „OFF only“; „ON only“</p>

<p>3.5 Calibration Brightness value</p>	
<p><i>calibration</i></p>	<p>„NO“ : factory calibration is enabled (default) Reset to factory calibration: this is possible any time by setting "NO" and subsequent reprogramming of the detector. "YES": this option opens two more windows:</p>
<p><i>AD calibration value</i></p>	<p>Read <i>AD calibration value</i> (at object 10) in the ETS and register in the window. Note: Use 7 .001 2 byte unsigned counter in the menu <i>value / send</i> type. The read AD value appears in the menu such as i.e. <i>value of received: 739 pulses</i></p>
<p><i>lux value</i></p>	<p>Read existing brightness with lux meter and register as reference value in the corresponding window.</p>
	<p>For more details see description of object "AD calibration"</p>

<p>3.6 Evaluation PIR</p>	
<p><i>active sensors</i></p>	<p><i>The four PIR sensors can be activated individually or in groups. The numbers 1,2,3,4 correspond to the positions 1,2,3,4 in the figure below.</i></p>
<p><i>sensitivity adjustment 1 = minimum, 10 = maximum</i></p>	<p><i>The sensitivity can be adjusted from 1 to 10 The default value is 5</i></p>

numbering of PIR sensors



The PIR sensors 1 2 3 4 can be activated individually or in groups. The localization of the 4 positions is shown in the figure above.

3.7 Constant light control

1.1.1 Swiss Garde 360 Presence KNX/KLR

constant light

constant light controller	enabled
Send difference	5%
preset setpoint	500 lx
switching ON/OFF by	presence detection light
Cycle Transmission time	no cyclic transmission
switch On value	50%
switch On timeout	5 s
force output at ON	maximum brightness
force output at OFF	minimum brightness
relative dimming time	8 s
take over setpoint after	5 s
write changed setpoint to flash	disabled
light moods	disabled
PID parameter	standard

OK Cancel Default Info Help

3.8 Constant light parameters	
<i>constant light controller</i>	This parameter enables or disables the constant light controller.
<i>send difference</i>	This parameter (from 1% to 100%) determines the tolerance window, which must be exceeded in order to send a new brightness value.
<i>preset setpoint</i>	The setpoint in lux for constant light control can be preset in the ETS. It can also be changed through the objects 17 and 18 (constant light - dimming relative and constant light - dimming absolute).
<i>switching ON/OFF by</i>	Enabling constant light control, i.e. turning on the light can be made from three different sources: object, presence detection light and presence detection HCV.
<i>cycle transmission time</i>	This determines the cycle interval of the last brightness value even if this one has not exceeded its tolerance window.
<i>switch On value</i>	The switch On value can be set from 1% to 100%.
<i>switch On timeout</i>	This parameter defines the initial delay for starting up of the constant light controller.
<i>force output at ON</i>	With this parameter, the function of constant light controller can be set to: <i>no reaction, minimum brightness, maximum brightness</i>
<i>force output at OFF</i>	With this parameter, the function of constant light controller can be set to: <i>no reaction, minimum brightness, maximum brightness</i>
<i>relative dimming time</i>	With this parameter, the time for the relative dimming can be set. This has great influence on the dimming softcontrol.
<i>take over setpoint after</i>	This parameter sets the time delay after which a new setpoint will be recognized and stored in the RAM memory.
<i>write changed setpoint to flash</i>	With this parameter a new setpoint can be written to the flash memory.
<i>light moods (light scenes)</i>	Various lux values can be set as light scenes (light moods). These can be enabled through object 21 as well.
<i>PID parameters</i>	The PID parameters have been optimized for most applications and will give good results in standard mode. They should not be changed, if possible. If necessary the PID parameters can be changed by the user (<i>user defined</i>). However this requires a deep understanding of control techniques in order to get a fast and stable control system.
<i>Dead band</i>	The deadband is an area within which the actual light value can change without generating new control commands. The default value for the dead band is 2. The lux value of the dead band can be extracted from the table below. <u>Example:</u> Dead band value = 2 Brightness = 500 lux The resulting tolerance is: +/- 24 lux This means that the actual value can change from 476 lux to 524 lux without sending new control telegrams to the actor.
<i>Cycle time</i>	The cycle time is specified in milliseconds and corresponds to the interval of updating the control commands.

Short description of control parameters:

parameters	rise time	overshoot	response	error correction
Kp	falling	rising	fast	high
Ki	falling	rising	faster	low
Kd	weak	falling	slower	lowest

3.9 Table deadband

brightness lux

+/- tolerance lux

		deadband									
		1	2	3	4	5	6	7	8	9	10
brightness	100	2	5	7	10	12	15	17	20	23	26
	200	5	9	14	19	24	30	35	40	46	52
	300	7	14	21	29	37	44	52	61	69	78
	400	9	19	29	39	49	59	70	81	92	104
	500	12	24	36	48	61	74	87	101	115	129
	600	14	28	43	58	73	89	105	121	138	155
	700	16	33	50	68	85	104	122	142	161	181
	800	19	38	57	77	98	119	140	162	184	207
	900	21	42	64	87	110	133	157	182	207	233
	1000	23	47	72	96	122	148	175	202	230	259
	1100	26	52	79	106	134	163	192	222	253	285
	1200	28	57	86	116	146	178	210	243	276	311
	1300	30	61	93	125	159	193	227	263	299	337
	1400	33	66	100	135	171	207	245	283	322	362
	1500	35	71	107	145	183	222	262	303	345	388
	1600	37	75	114	154	195	237	280	324	368	414
	1700	40	80	122	164	207	252	297	344	391	440
1800	42	85	129	174	220	267	315	364	414	466	
1900	44	90	136	183	232	281	332	384	438	492	
2000	47	94	143	193	244	296	350	405	461	518	

4 FUNCTIONAL BLOCKS

The functionality of the presence detector can be divided in the following blocks:

- motion detection
- brightness metering
- lighting control channel
- HCV control channel
- threshold lighting
- remote control (receiver)
- constant light controller

The motion detector and the brightness sensor (lux) are connected to the light control channel and the HCV control channel which work independently from each other.

The constant light controller gets the actual brightness value from the light sensor. The start and stop of the constant light controller can be done using communication object 16 or automatically after motion detection with the light or HCV channel.

Initial start behaviour of the presence detector

After power up or after return of the bus voltage, there will be generated a ON telegram on the bus. This is due to the transient response of the internal circuit.

4.1 LIGHT CONTROL CHANNEL

The light control channel has two modes which are set via the parameter *operating mode of detector*.

Available settings are:

- fully automatic
- semi automatic

The differences between *fully automatic* and *semi automatic* operation modes are:

- The fully automatic mode has three operating status: ready, active and passive.
- The semi automatic mode has two operating status: ready and active
- The semi automatic mode does not switch on automatically with motion detection. Light can be switched on only through a external switch.
- In fully automatic operation mode, the IR remote control can send the commands ON, OFF and AUTO through the force object.
- In the semi automatic operating mode, the IR remote control can send the commands ON, OFF only through the external switch input. AUTO has no function here.

The set IR channel (CH1 or CH2) in the ETS Menu must be also set with the slide switch on the back at of the remote control.

4.1.1 OBJECT 0 OUTPUT – LIGHT - SWITCH

After each motion detected this output sends a "ON " command and starts the follow-up timer. The follow up time can be set from 1 s to 4 hrs. At the end of the preprogrammed time interval a "OFF" command ist sent to the output (object 0).

4.1.2 OBJECT 1 EXTERNAL SWITCH / STATUS - LIGHT - SWITCH

Object 1 "external switch / status" can be used in two different ways:

- as an input for a external push button which will switch on the lighting directly.
- as an input for monitoring the status or the input of an actuator.

In both cases, a received telegram „ON“ sets the detector in ON state and a „OFF“ telegram in the ready state.

Whether commands for ON or OFF will be sent during the transitions, depends on the parameter *sending conditions for external push button*.

After having received a **ON** command, the follow up timer starts as if a motion had been detected. In the sequence lighting is switched off again.

After having received a **OFF** command the detector remains in its passive status during which it will not detect any motion. After having passed the *idle time after switch off*, the detector is ready again.

The idle time after switch off can be programmed in the **light** menu.

4.1.3 OBJECT 2 EXTERNAL MOVEMENT - LIGHT - SWITCHING

At Object 2 *external movement - light - switching* additional detectors can be connected.

The received signal from external presence detectors is processed the same as it was from its own detector and works in parallel.

Object 2 can be used to set up a **Master-Secondary Detector configuration** as follows:

Secondary devices: Connect **all outputs** of the **secondary devices** *output-light-switching* (object 0) to the **input** *external movement-light-switching* (object 2) of the **master device**.

Set the **follow-up time** of **all secondary devices** to **1 second** (minimum value).

Set *brightness threshold below active sensor* to *2000 lux*.

Set *idle time after switch off* to the required value.

Using this parameter too much traffic on the bus can be inhibited.

Master device: Connect **input** *external movement-light-switching* (object 2) of the **master device** to all **outputs** *output light-switching* (object 0) of the **secondary devices**.

4.1.4 OBJECT 3 INPUT – LIGHT - LOCK

The significance of this object is determined by the parameter *Light* \Rightarrow *force or lock object*.

force object:

Object 3 used as ***force object*** has 3 values which can be received by a **2 bit command**:

(1) ***force object ON*** (control = 1, value = 1)

A ***ON command*** is sent unconditionally to the *output – light* (object 0).

The follow up timer is disabled and the timer *release time* starts.

If after having terminated the release time and no further command is sent to the force object, normal operation is resumed.

(2) ***force object OFF*** (control = 1, value = 0)

A ***OFF command*** is sent unconditionally to the *output – light* (object 0).

The follow up timer is disabled and the timer *release time* starts.

If after having terminated the release time and no further command is sent to the force object, normal operation is resumed.

(3) ***force object auto*** (control = 0, value = 0)

Normal operation is resumed immediately .

lock object:

Object 3 used as ***lock object*** has 2 values which can be received by a **1 bit command** **0** and **1**:

The response to a switch command on this object is controlled by two more parameters:

Light \Rightarrow *if lock object = 0* , and *Light* \Rightarrow *if lock object = 1* ,

Both parameters can specify one of the following commands:

- forced ON
- forced OFF
- automatic
- lock (actual state)
- do nothing

Attention!

Incorrect setting of parameters, such as: *lock object*, *lock at 0* and *no action at 1* and *release time restraint OFF* can completely inhibit the correct function of the presence detector.

4.2 HCV CHANNEL (= HVC CHANNEL)

The HCV (heating conditioning ventilation) channel has the same objects and same modes as the light channel. TI works also in the same way as the light channel.

The motion detection function however has been expanded and substituted by a “longer presence detection”. This is done by setting several equally long monitoring time windows. There must occur at least one motion detection during each time slot.

The parameters are:

number of monitoring time windows
length of monitoring time window (s)

The total delay time for an action on the output (object 4) is the multiplication of the two parameters and it can vary as much as one interval of the set *length of monitoring time window*.

4.2.1 OBJECT 4 OUTPUT - HCV - SWITCHING

Object 4: *output climate (HCV) – switching* is similar to object 0 *output-light-switching*, but it has additional functions (see parameters HCV page 8).

4.2.2 OBJECT 5 EXTERNAL SWITCH / STATUS – CLIMATE (HCV) - SWITCHING

Object 5 is identical to object 1 of the light channel.

4.2.3 OBJECT 6 EXTERNAL MOVEMENT – LIGHT - SWITCHING

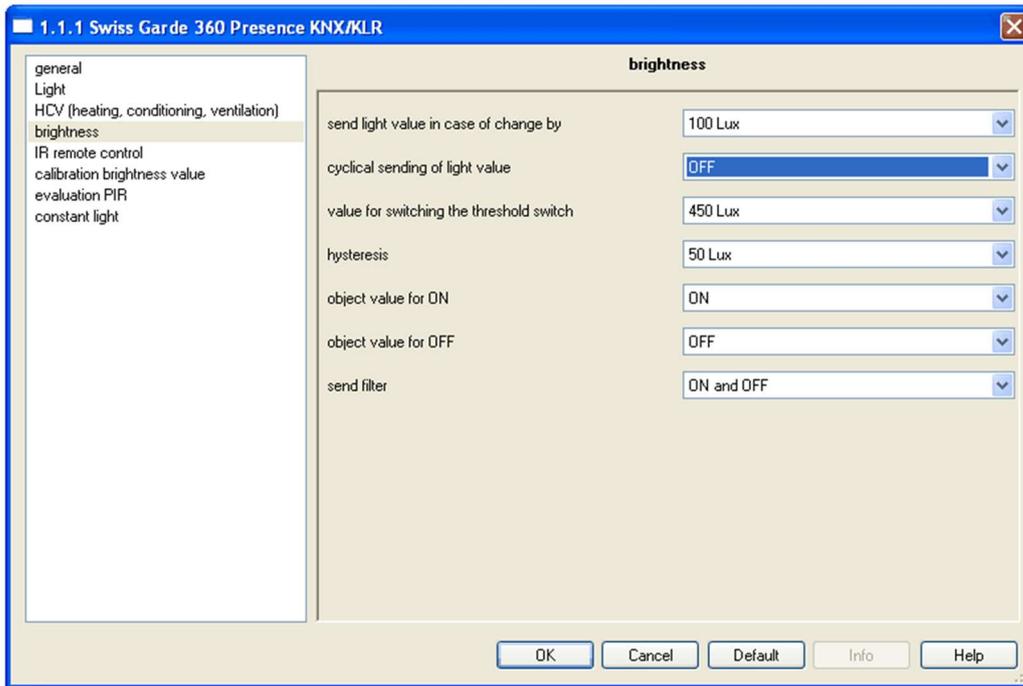
Object 6 is identical to object 2 of the light channel.

4.2.4 OBJECT 7 INPUT – CLIMATE (HCV) - LOCK

Object 7 is identical to object 3 of the light channel.

4.3 BRIGHTNESS THRESHOLD SWITCH

This block has two main output objects (8 and 9) : threshold switch brightness and brightness value.



4.3.1 OBJECT 8 THRESHOLD SWITCH BRIGHTNESS - SWITCHING

Object 8 sends a ON command when the measured brightness is greater than the parameter *value for switching the threshold switch*. When this value drops below the *threshold for switching* - (minus) *hysteresis* value a OFF command is sent.

4.3.2 OBJECT 9 BRIGHTNESS VALUE

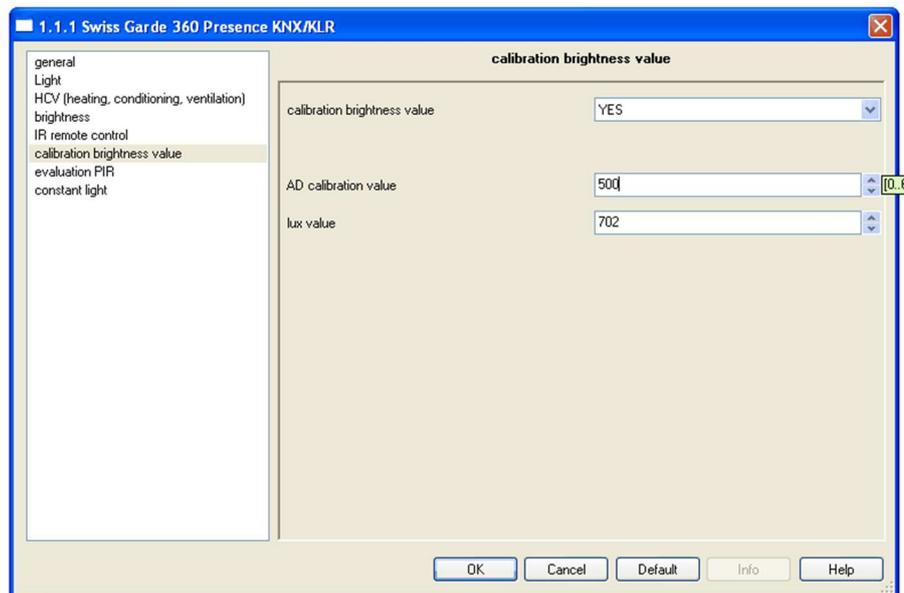
Object 9 sends the actual measured brightness value in lux. The transmission is initialized everytime the set parameter *send light value in case of change by xy* is exceeded or if *cyclical sending of light value* has been set to a determined interval in seconds. If *cyclical sending of light value* is set to OFF there will be no cyclical transmission at all.

4.4 AD CALIBRATION VALUE

Object 10 *AD calibration* value does not transmit automatically. The AD calibration value can only be read. Its unsigned 16 bit number represents the current AD converter value for the brightness.

The brightness measurement can be calibrated as follows:

1. Read actual brightness using a lux meter positioned aside from the motion detector.
2. Read AD calibration value at object 10 using the ETS software tool.
Please note: : In the ETS menu *value / send* use type **7.001 2 byte unsigned counter**.
 The AD value appears in the menu such as: *received value 739 pulses*
3. Register these two numbers *AD calibration value* and *lux value* in the table under full access .



4.5 OBJECTS FOR CONSTANT LIGHT CONTROL

4.5.1 OBJECT 16 CONSTANT LIGHT – SWITCH ON/OFF

At this input the constant light control can be switched ON and OFF.

With the parameter *switching ON/OFF by* the constant light control can be switched by presence through the light or HLK channel.

4.5.2 OBJECT 17 CONSTANT LIGHT – DIMMING RELATIVE

Using this object, the current value changed with relative dimming steps of 1% .

Using a KNX push button light can be dimmed and set to a new brightness level.

The new light-current value can then be displayed on a KNX touch panel through object 9: *brightness value*.

Important: In the menu *constant light* ⇒ *take over setpoint after* you can define the the period during which the controller will remain off. After this interval, the new value is written to the RAM (not to the flash memory)!

Warning: This new value remains stored in RAM, even after having switched off the light output in the absence of people in the scanned area.

The default value can only be restored after having made a cold start with the unit (= BUS voltage reset).

4.5.3 OBJECT 18 CONSTANT LIGHT – DIMMING ABSOLUTE

Using this object the actual setpoint can be changed by sending a new dim value over the bus.

4.5.4 OBJECT 20 CONSTANT LIGHT – FORCE OUTPUT

In accordance to the parameters *force output at ON* and *force output at OFF* various options can be selected: no reaction, minimum brightness, maximum brightness

4.5.5 OBJECT 21 CONSTANT LIGHT - SCENE

Input constant light-scene. 8 different ajustable scenes can be selected through ETS. This object does not switch it only changes the desired preset brightness value in lux of the scene.

4.5.6 OBJECT 22 CONSTANT LIGHT - OUTPUT

With this object you can control a dim actor with absolut dim commands in % of brightness.